

NOTE: IF MANHOLE DEPTH IS LESS THAN 3 FEET, TOP SECTION SHALL HAVE A CONCENTRIC OPENING.

MINIMUM INSIDE DIAMETER OF MANHOLE SHALL BE AS FOLLOWS:

PIPE SIZE	MIN. MANHOLE DIAMETER
15" OR LESS	48"
18" TO 30"	60"
OVER 30"	72"

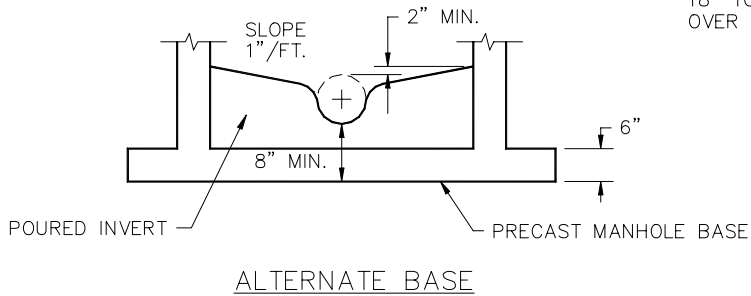


FIGURE15.DWG

TOWN OF PONCHA SPRINGS, COLORADO

**FIGURE 15
SHALLOW DEPTH MANHOLE (FLAT TOP)**